


| REVISION HISTORY |             |      |          |
|------------------|-------------|------|----------|
| REV              | DESCRIPTION | DATE | APPROVED |
|                  |             |      |          |

2X  $\varnothing$ .219  
SECURE BARREL BOLT  
OUTSIDE ENCLOSURE  
WITH 2X 10-24 SCREWS  
FROM INSIDE ENCLOSURE

6X  $\varnothing$ .219  
SECURE WITH 6X 10-32  
HEX HEAD BOLTS

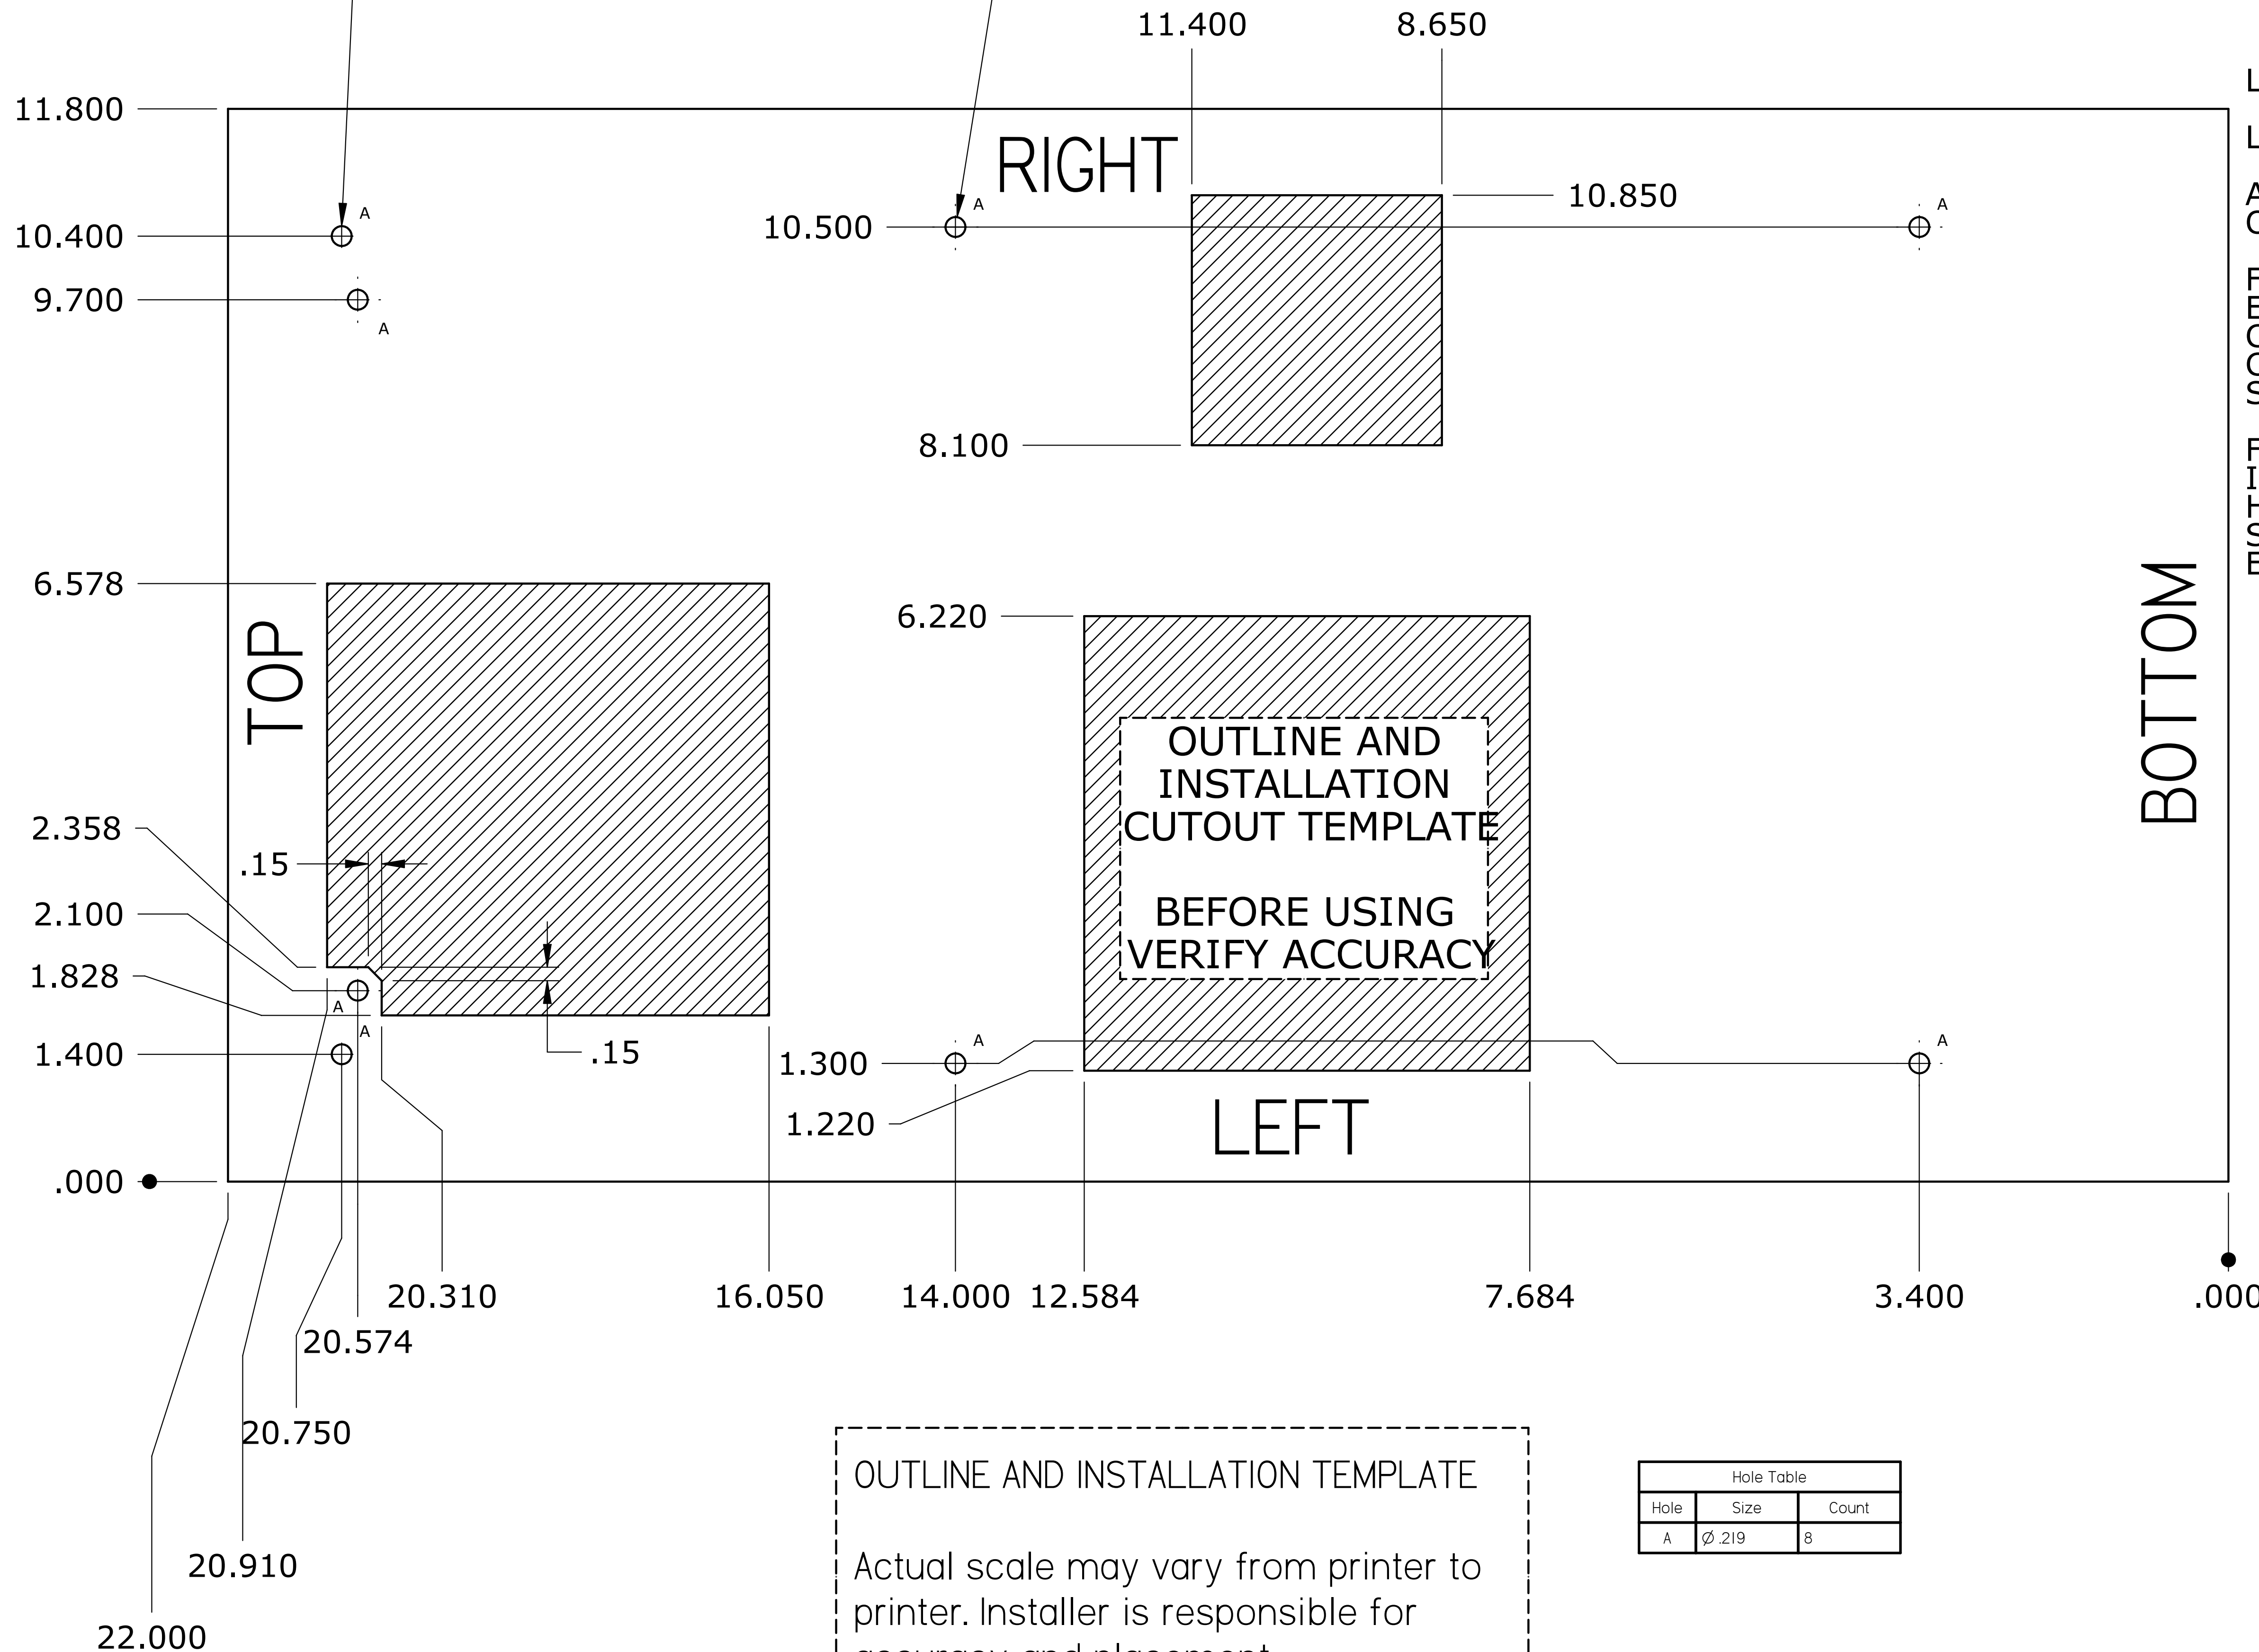

LOCATE DESIRED ELEVATION

LOCATE CUTOUTS AND HOLES

APPLY GASKET TO MOUNTING FACE OF UNIT.

FASTEN 2 BARREL BOLTS OUTSIDE ENCLOSURE AND HANG AIR CONDITIONER BY THE AIR CONDITIONER'S KEYHOLE SLOTS AT THE TOP.

FASTEN AIR CONDITIONER FROM INSIDE ENCLOSURE WITH 6 X 10-32 HEX HEAD BOLTS (1/2" LONG SUPPLIED FOR UP TO 12 GA. ENCLOSURES)

OUTLINE AND INSTALLATION TEMPLATE

Actual scale may vary from printer to printer. Installer is responsible for accuracy and placement.

| Hole Table |                    |       |
|------------|--------------------|-------|
| Hole       | Size               | Count |
| A          | $\varnothing$ .219 | 8     |

| NAME   | DATE     | TITLE                          | SIZE                             | DWG NO       | REV |
|--|----------|--------------------------------|----------------------------------|--------------|-----|
| atittle  | 03/13/08 | INSTALLATION TEMPLATE<br>NE015 | D                                | NE015 CUTOUT |     |
| UNLESS OTHERWISE SPECIFIED<br>DIMENSIONS ARE IN INCHES<br>ANGLES ±1° or 1 PL ±0.5°<br>2 PL ±0.02 3 PL ±0.010 |          |                                | FILE NAME: isc_ne_015_cutout.dft |              |     |
| SCALE:   |          | WEIGHT:                        | SHEET 1 OF 1                     |              |     |