


REVISION HISTORY			
REV	DESCRIPTION	DATE	APPROVED

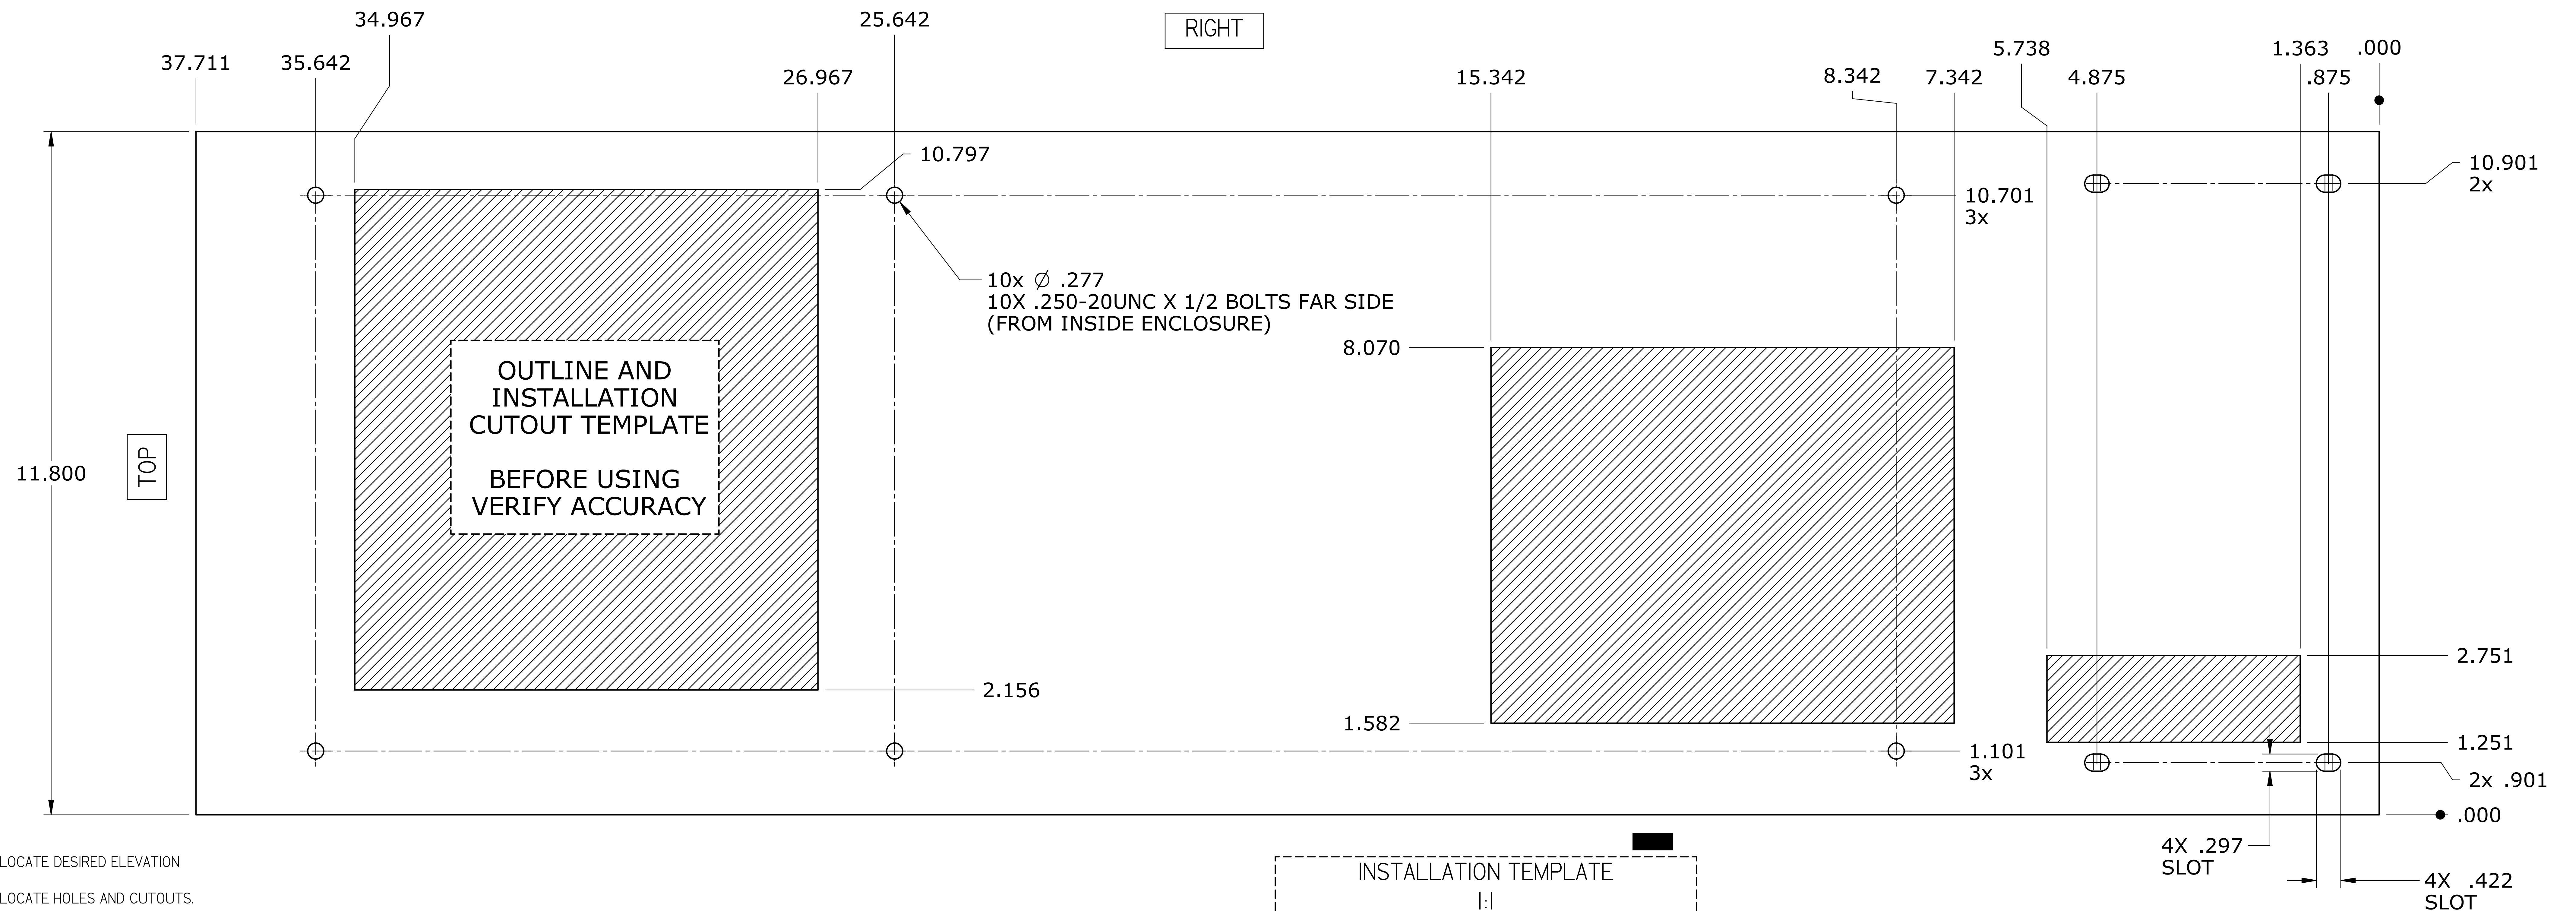

OUTLINE AND
INSTALLATION
CUTOUT TEMPLATE
BEFORE USING
VERIFY ACCURACY

INSTALLATION TEMPLATE
I:I
Print scale may vary from printer to
printer.
Installer is responsible for final
placement.

LOCATE DESIRED ELEVATION
LOCATE HOLES AND CUTOUTS.
DRILL HOLES AND CUT OUT VENTILATION HOLES
APPLY GASKET TO MOUNTING FACE OF UNIT.
BEGINNING AT THE TOP FASTEN AIR CONDITIONER FROM INSIDE ENCLOSURE
WITH 6 X 10-32 HEX HEAD BOLTS (1/2" LONG SUPPLIED FOR UP TO 12 GA.
ENCLOSURES)

NAME	DATE	TITLE	REV
DRAWN: attitle	05/08/08	INSTALLATION TEMPLATE NE020-486	
CHECKED:			
ENG APPR:			
MGR APPR:			
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES ANGLES ±1° or 1 PL ±0.5° 2 PL ±0.02 3 PL ±0.010		DWG NO: NE020-486 CUTOUT	
SCALE:	WEIGHT:	FILE NAME: isc_ne_020-486_cutout.dft	SHEET 1 OF 1