


REVISION HISTORY			
REV	DESCRIPTION	DATE	APPROVED

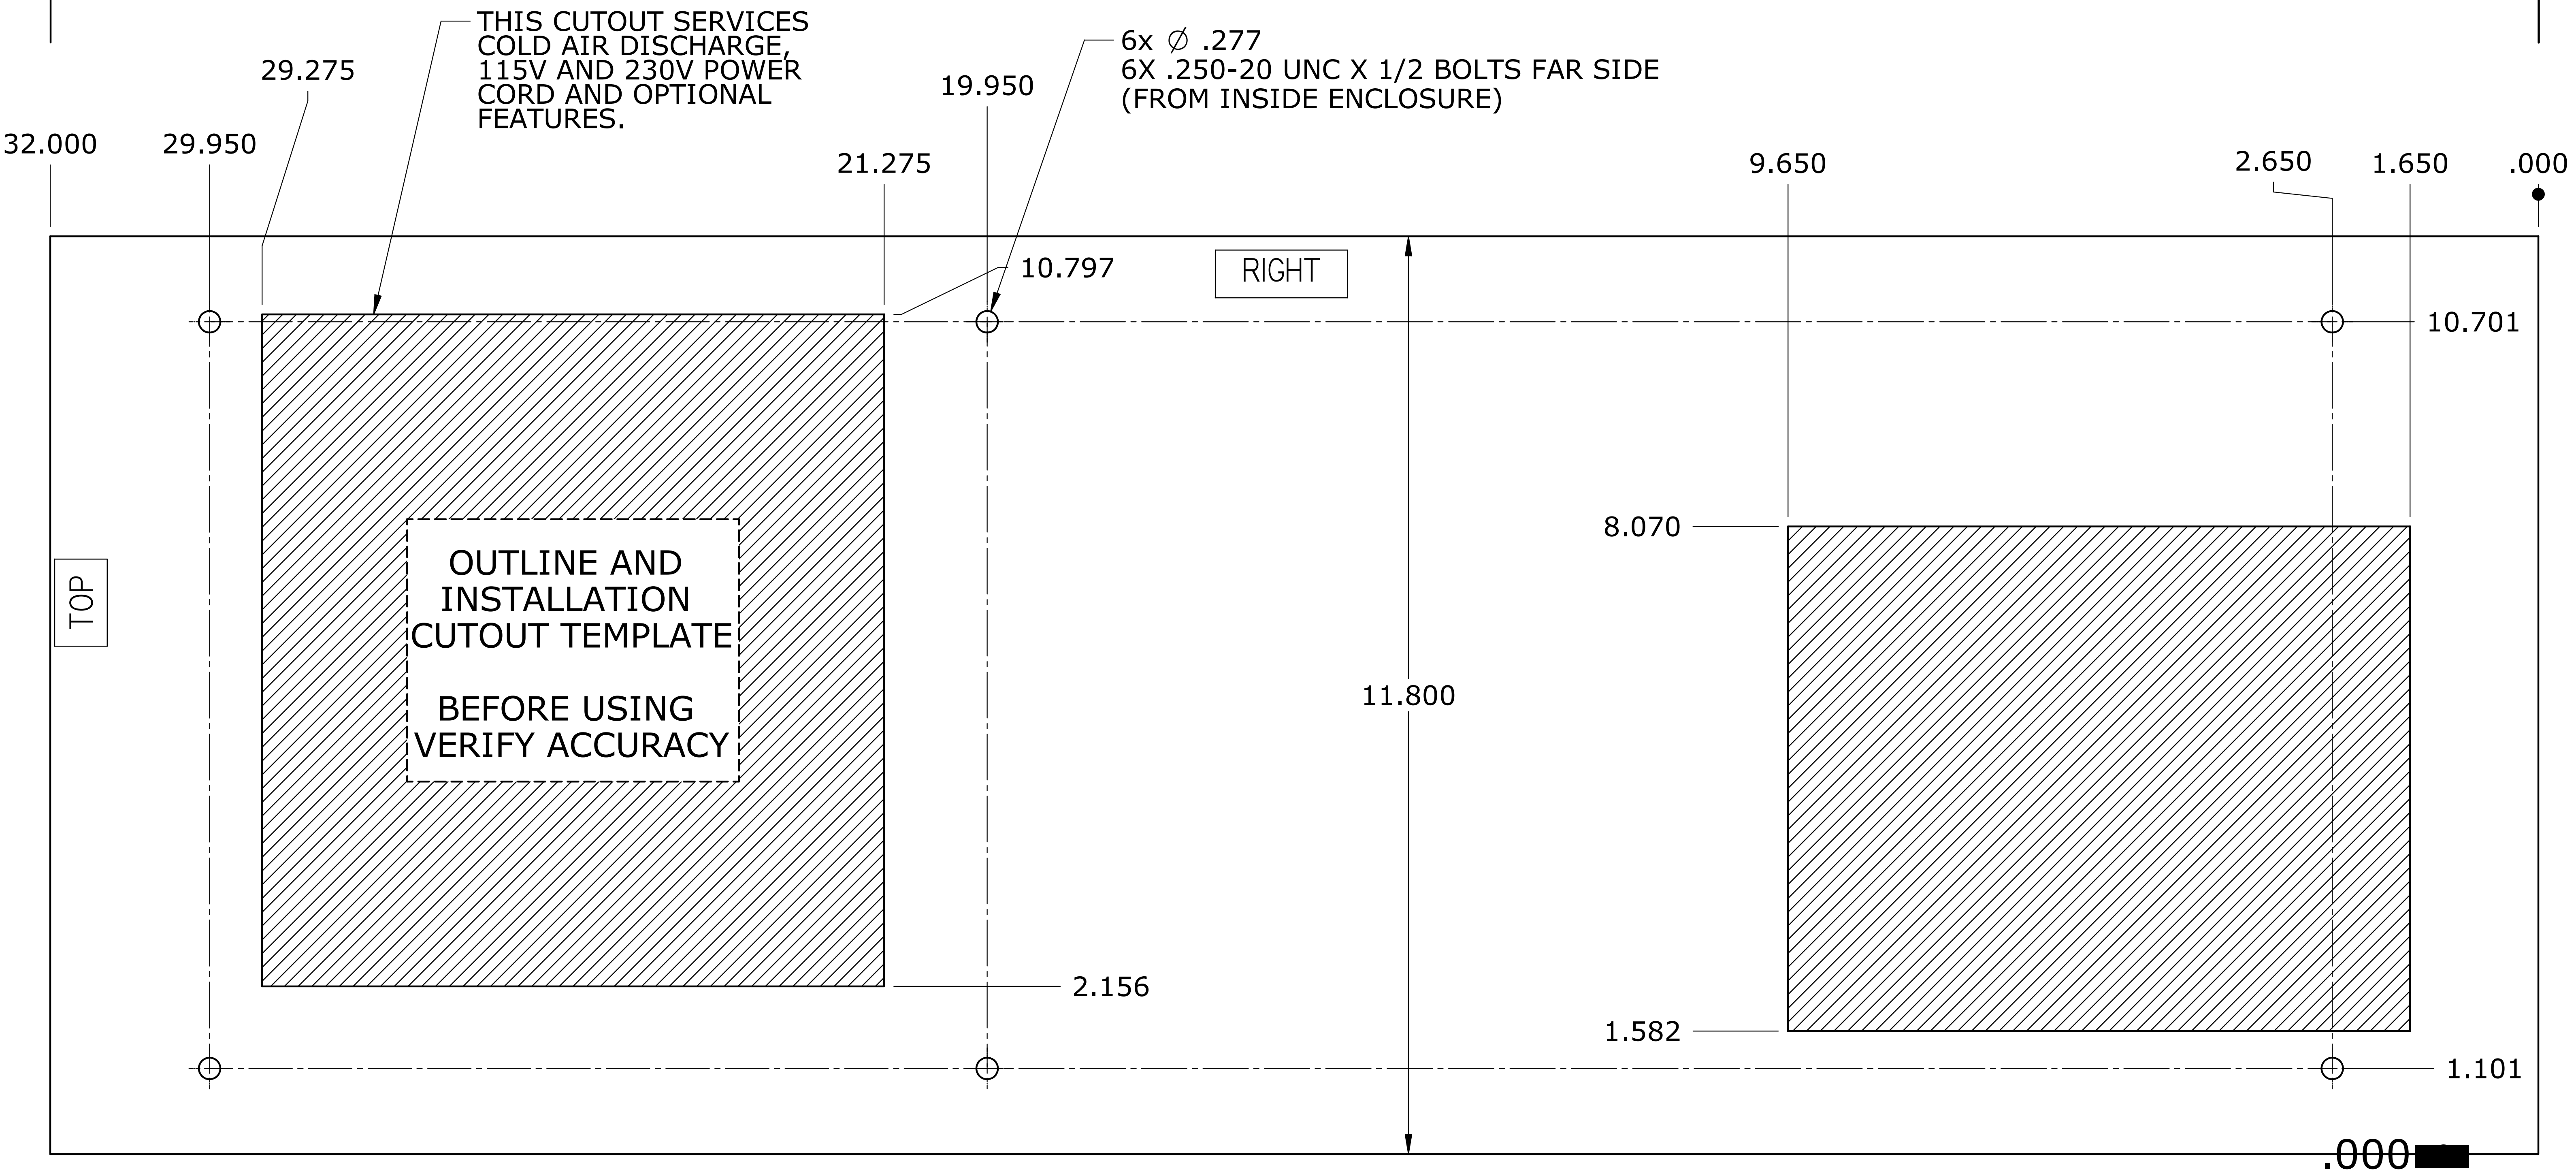

TEMPLATE IS VIEWED FROM OUTSIDE ENCLOSURE

LOCATE DESIRED ELEVATION.

LOCATE HOLES AND CUTOUTS.

DRILL HOLES AND CUT OUT VENTILATION HOLES.

APPLY GASKET TO MOUNTING FACE OF UNIT.

BEGINNING AT THE TOP FASTEN AIR CONDITIONER FROM INSIDE ENCLOSURE WITH HEX HEAD BOLTS (1/2" LONG SUPPLIED FOR UP TO 12 GA. ENCLOSURES).

INSTALLATION TEMPLATE
SUITABLE FOR NE020 2000 BTU/H

115V AND 230V
INCLUDING ALL OPTIONS

	NAME	DATE	
DRAWN	atittle	02/16/09	
CHECKED			TITLE
ENG APPR			INSTALLATION TEMPLATE GENERATION II NE020
MGR APPR			
			SIZE DWG NO
			D NE020 G2 CUTOUT
			FILE: isc_ne_020-G2_cutout.dft
			SCALE: WEIGHT: SHEET 1 OF 1