


REVISION HISTORY			
REV	DESCRIPTION	DATE	APPROVED

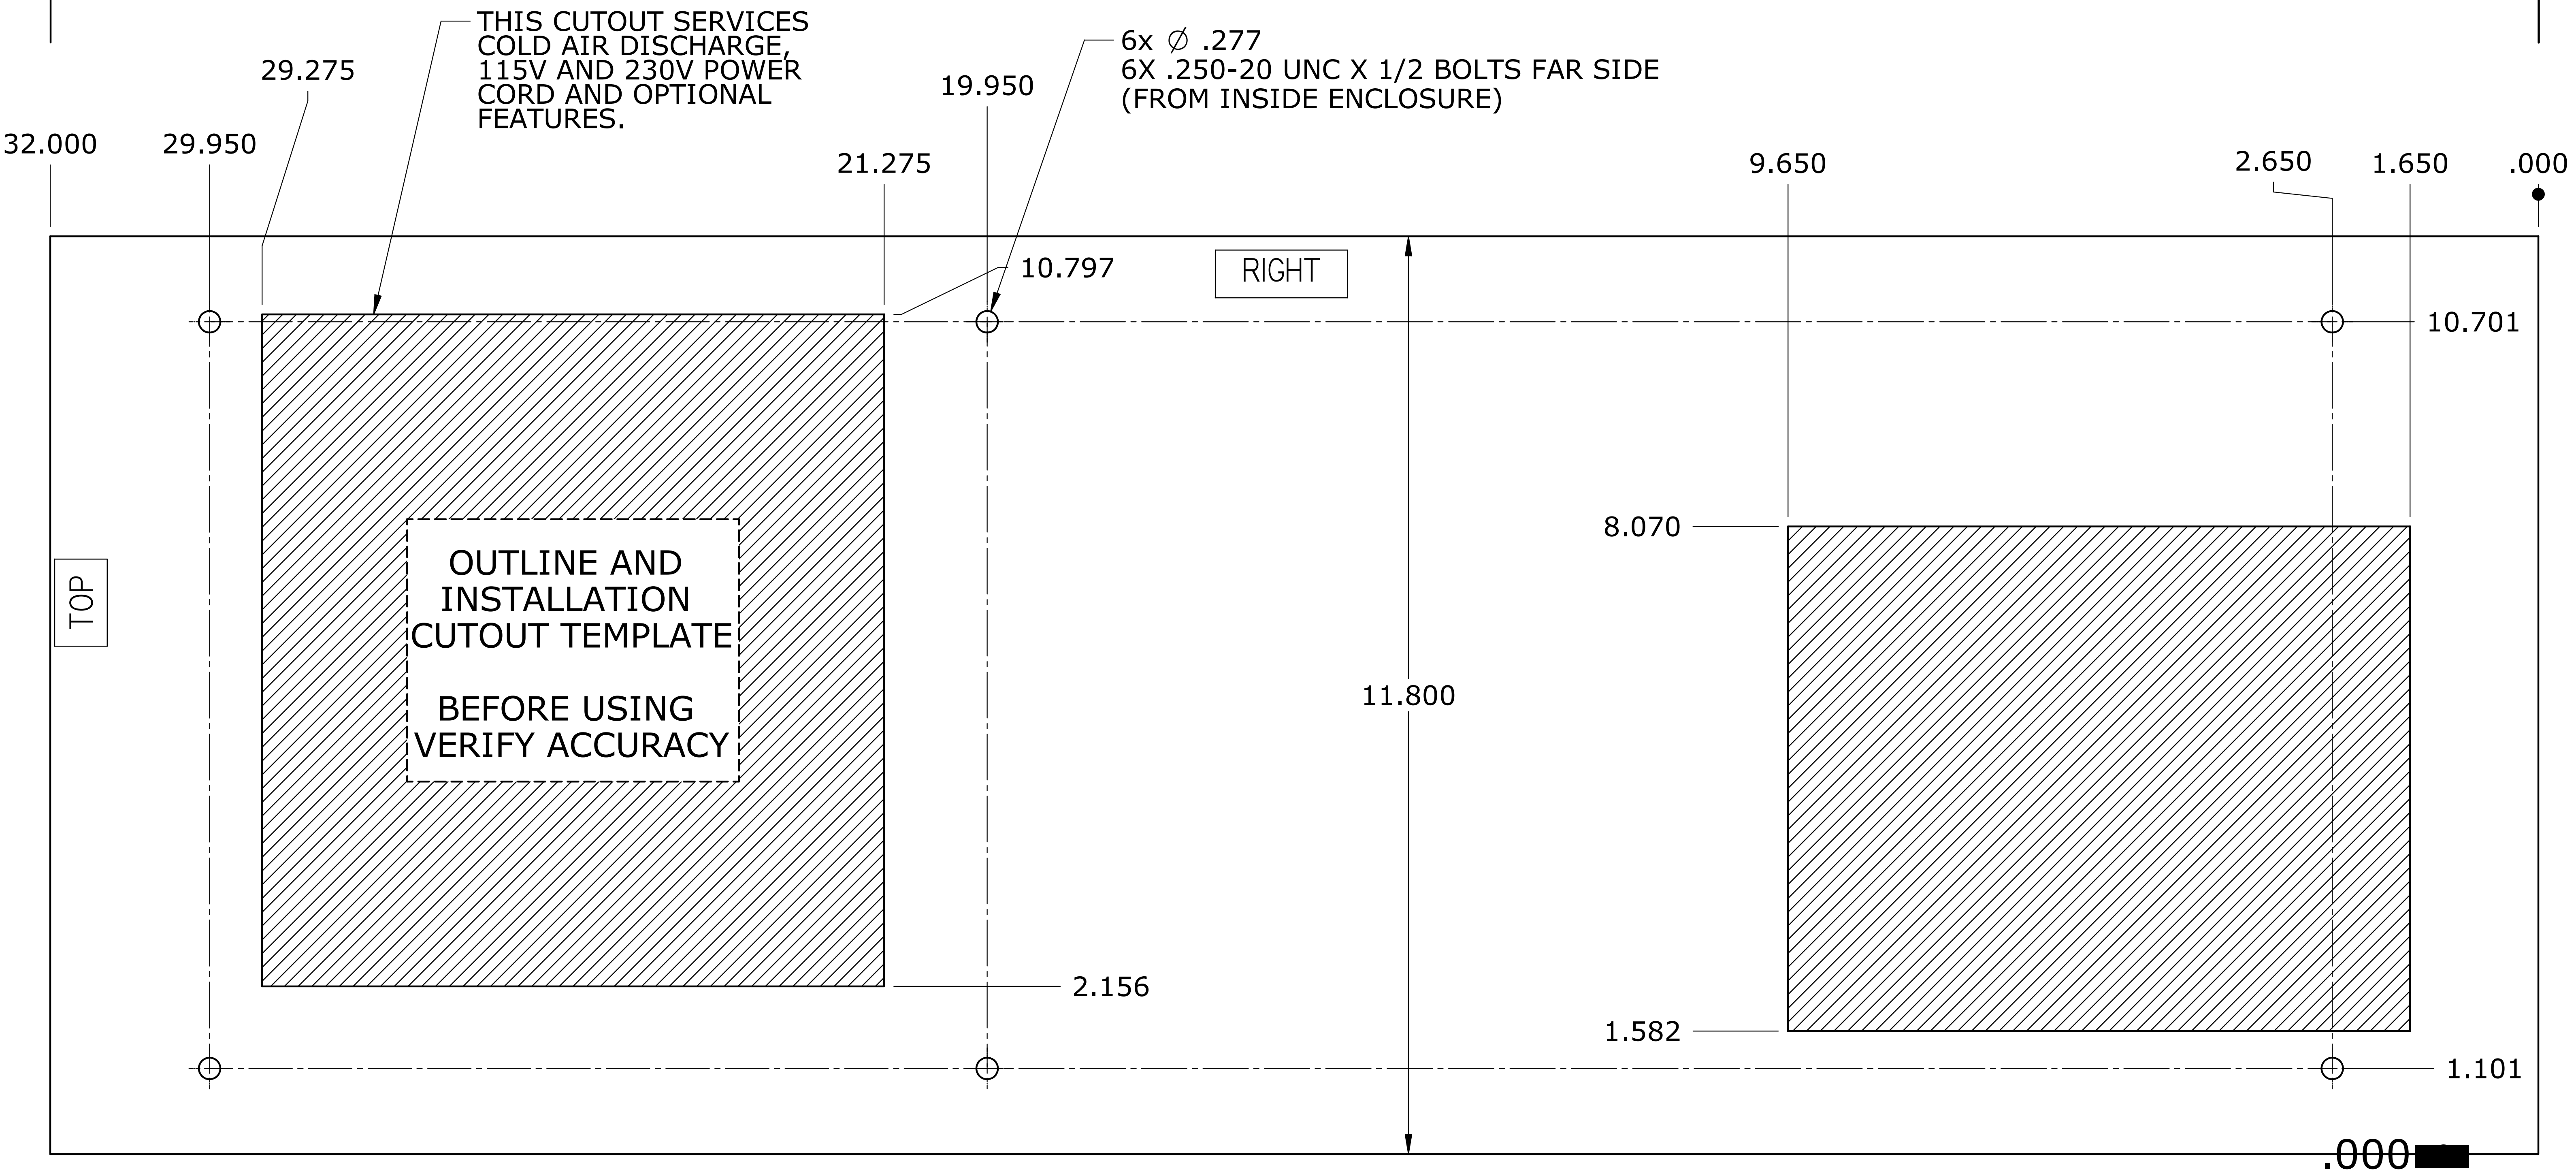

TEMPLATE IS VIEWED FROM OUTSIDE ENCLOSURE

LOCATE DESIRED ELEVATION.

LOCATE HOLES AND CUTOUTS.

DRILL HOLES AND CUT OUT VENTILATION HOLES.

APPLY GASKET TO MOUNTING FACE OF UNIT.

BEGINNING AT THE TOP FASTEN AIR CONDITIONER FROM INSIDE ENCLOSURE WITH HEX HEAD BOLTS (1/2" LONG SUPPLIED FOR UP TO 12 GA. ENCLOSURES).

INSTALLATION TEMPLATE
SUITABLE FOR NE030 3000 BTU/H

115V AND 230V
INCLUDING ALL OPTIONS

	NAME	DATE	
DRAWN	atittle	02/16/09	TITLE
CHECKED			INSTALLATION TEMPLATE GENERATION II NE030
ENG APPR			
MGR APPR			
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES ANGLES +1° or 1 PL ±0.5° 2 PL ±0.02 3 PL ±0.010	SIZE	DWG NO	REV
	D	NE030 G2 CUTOUT	
		FILE: isc_ne_030-G2_cutout.dft	
	SCALE:	WEIGHT:	SHEET 1 OF 1